



APPROVED PLAN DWG. N. PRY-BK-2005-C
SCALE 1/8"=1'-0"

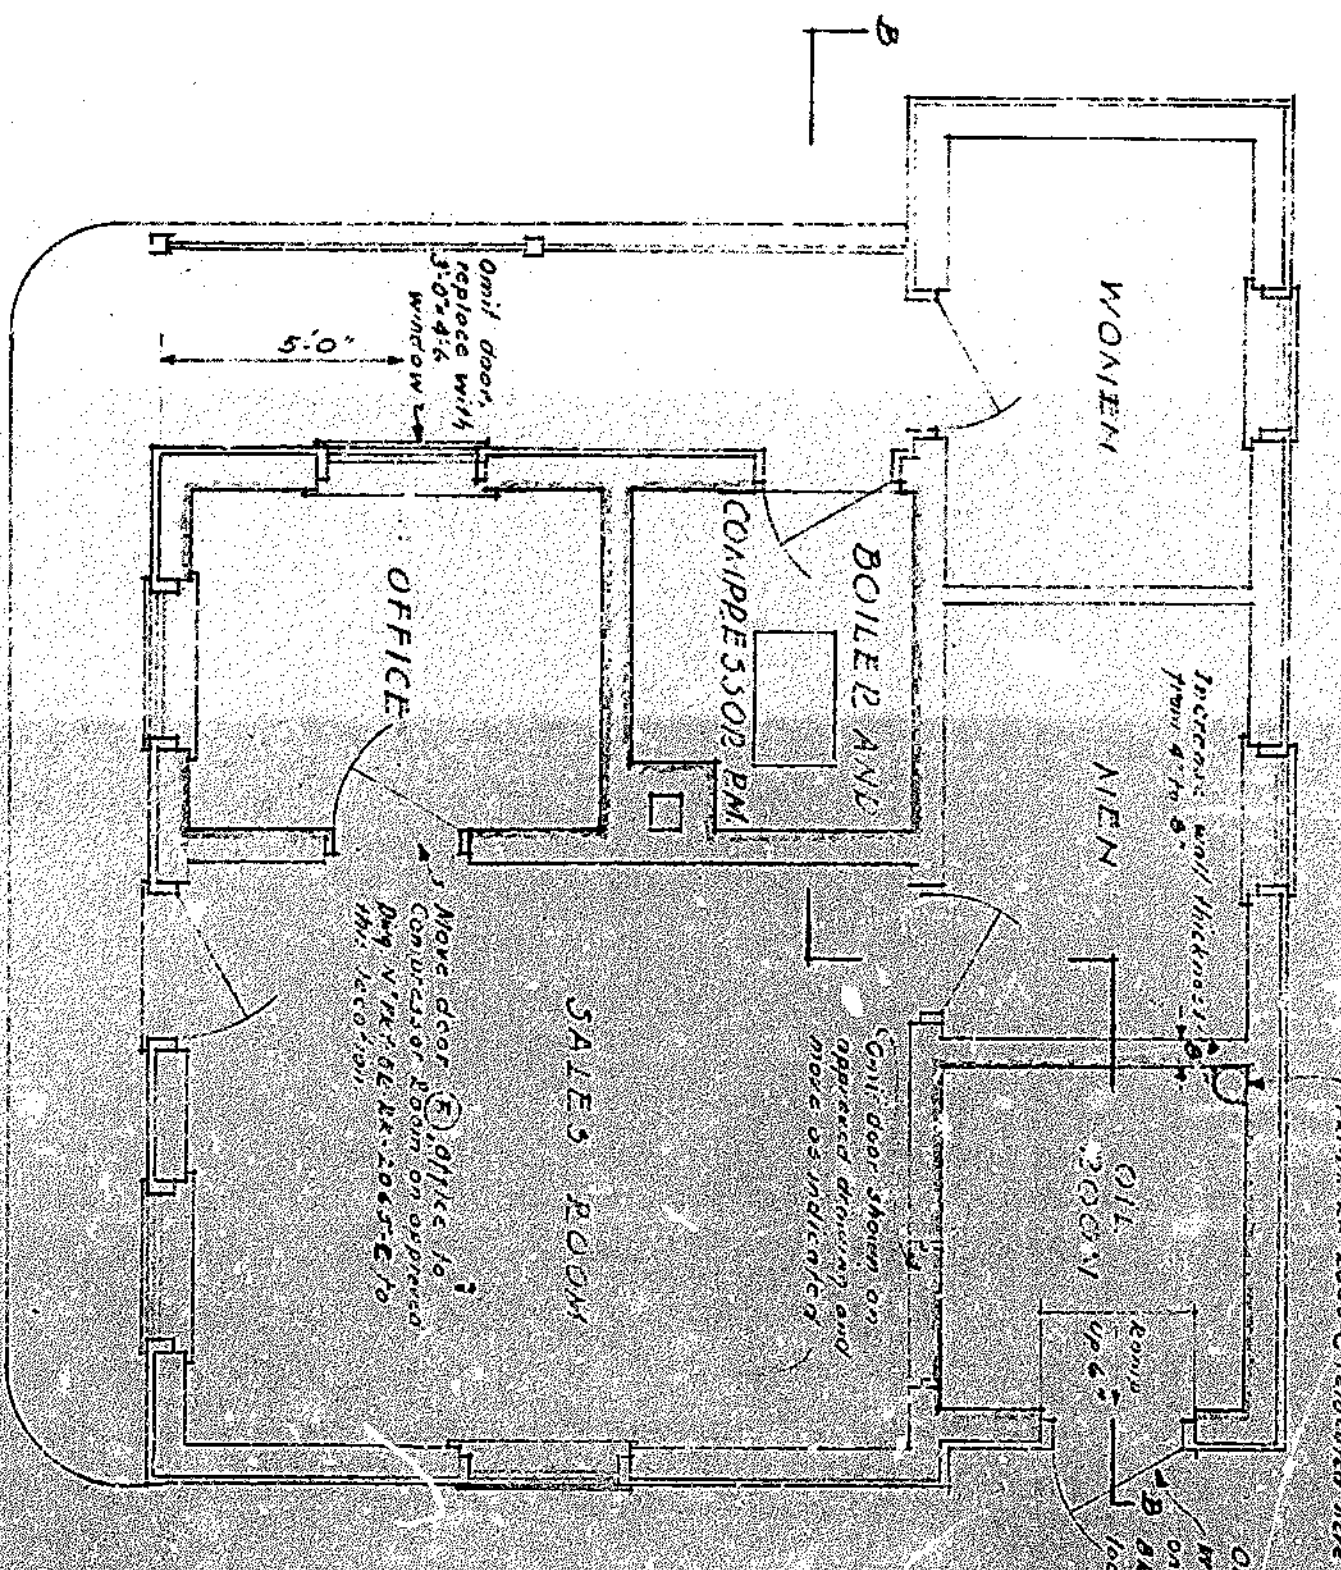


FLOOR PLAN
SCALE 1/8"=1'-0"
NOTE: Deviations to approved DWG. N. PRY-BK-2005-C, Sheet 1
BASIC DATA APPROVED DWG. N. PRY-BK-2005-C

ELECTRICAL SYMBOLS	
○	Lighting outlet; ceiling
□	Lighting outlet; bracket
⊕	Double convenience receptacle
⊖	Floor outlet; special as needed
⊙	3 P.S.T. switch
⊕	Explosion proof switch
⊖	Lighting panel
⊙	Weather proof receptacle


ELECTRICAL NOTES
Panel A to have 220 v. and 6-15A single pole breakers. Wiring circuits 1-1 to 4-8.
One leg of breaker to carry circuits 4-1, 4-5, 4-6.
The other 4-2, 4-3, 4-4, 4-7.
Height of outlets.
Local switches to be 4'-0" high.
Receptacles to be 1'-0" high.

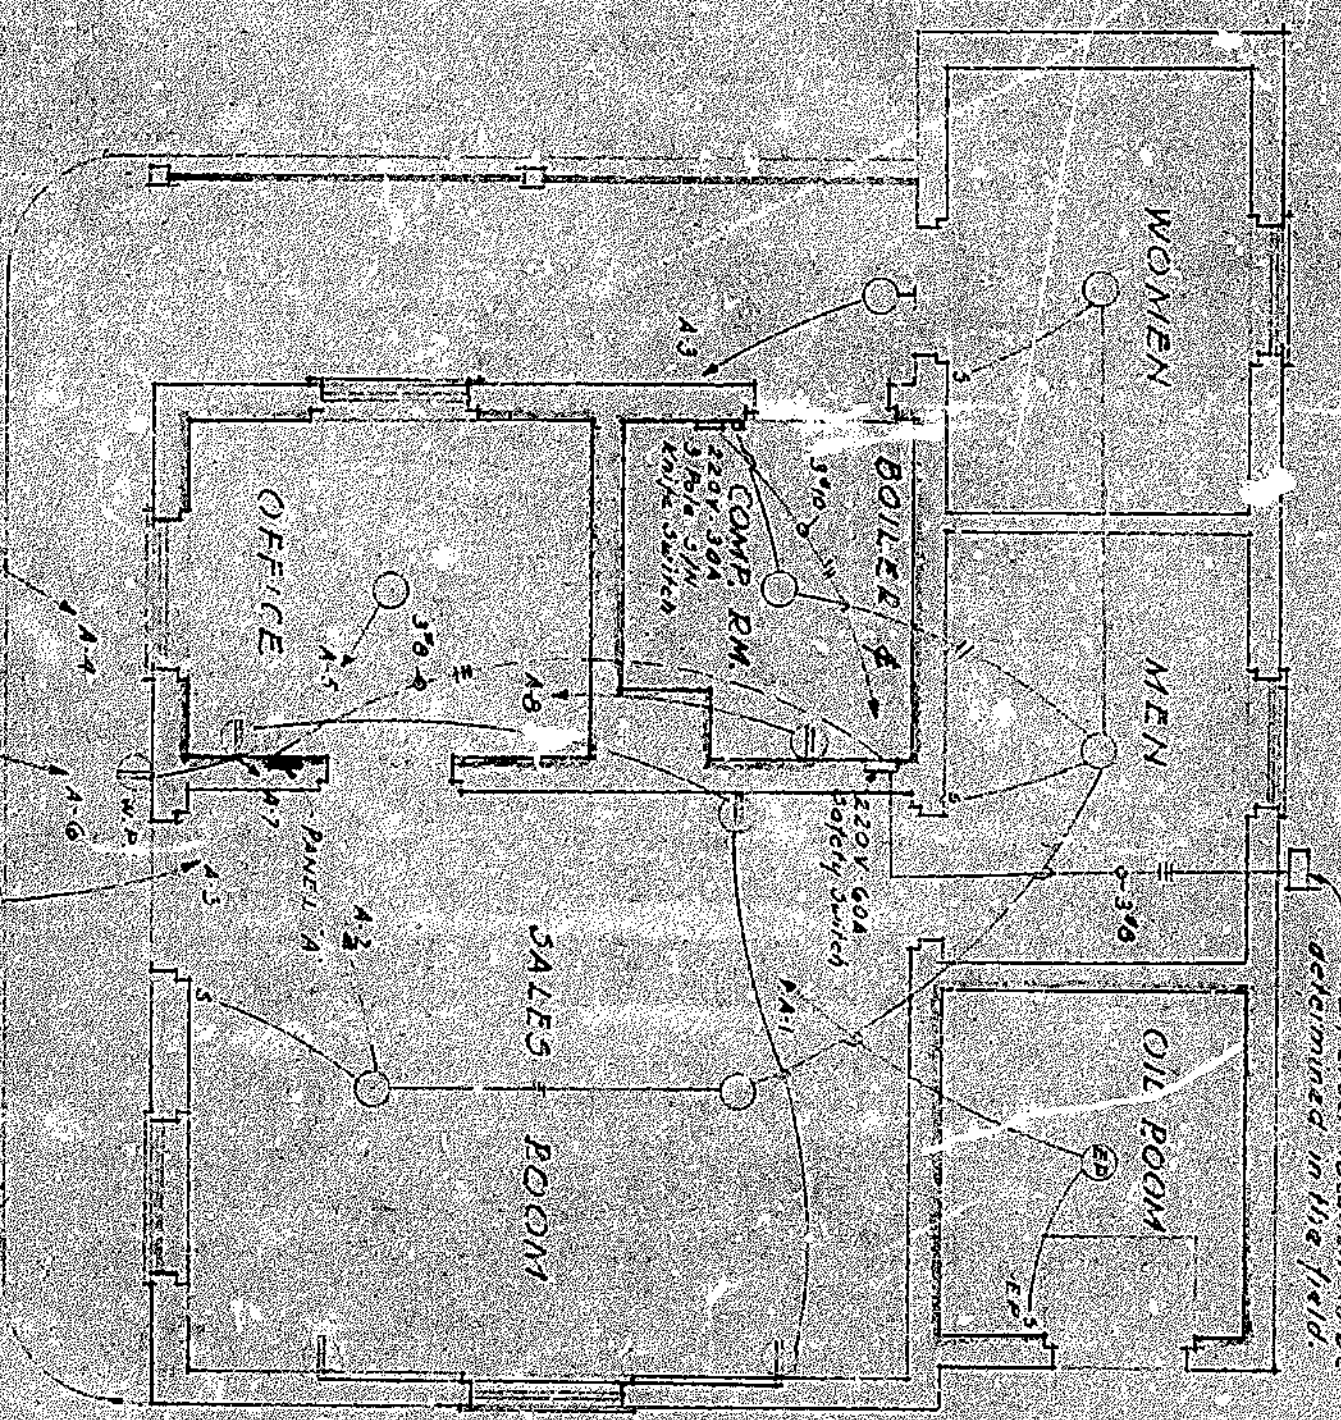

ELECTRICAL LAYOUT
SCALE 1/8"=1'-0"
NOTE: This plan supersedes the electrical plan shown on approved DWG. N. PRY-BK-2005-C, Sheet 5

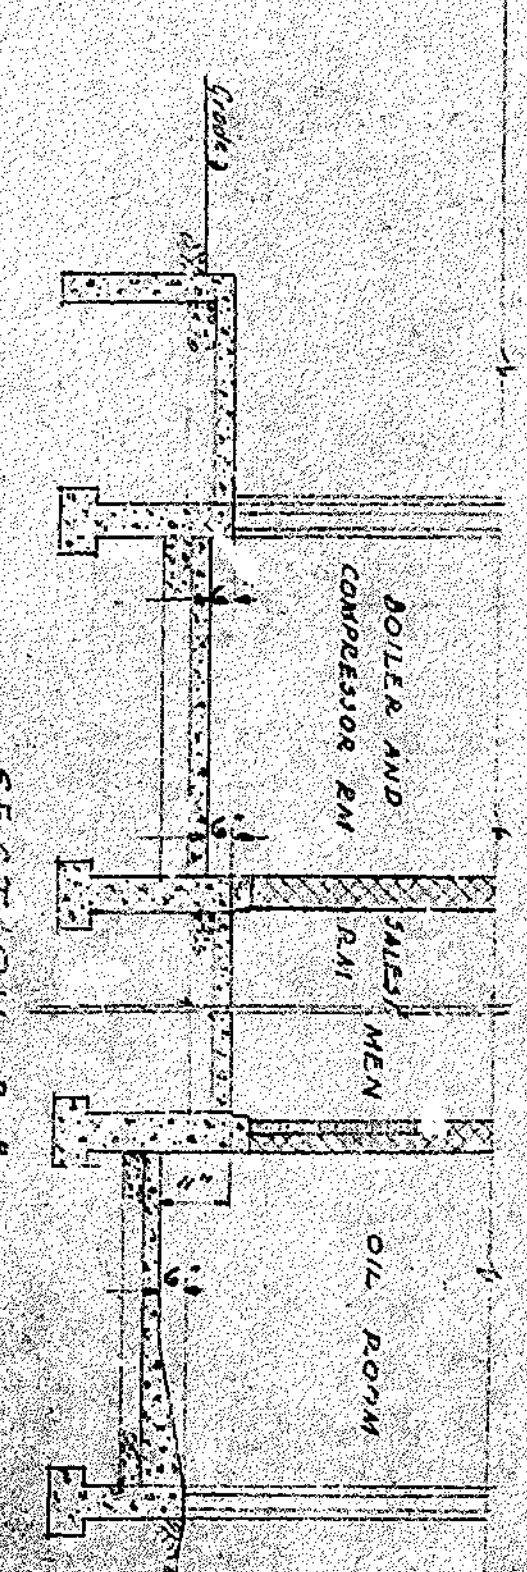

SECTION B-B
SCALE 1/8"=1'-0"
NOTE: Floor elevations shown in Section B-B are subject to change. Section A-A approved DWG. N. PRY-BK-2005-C, Sheet 1.

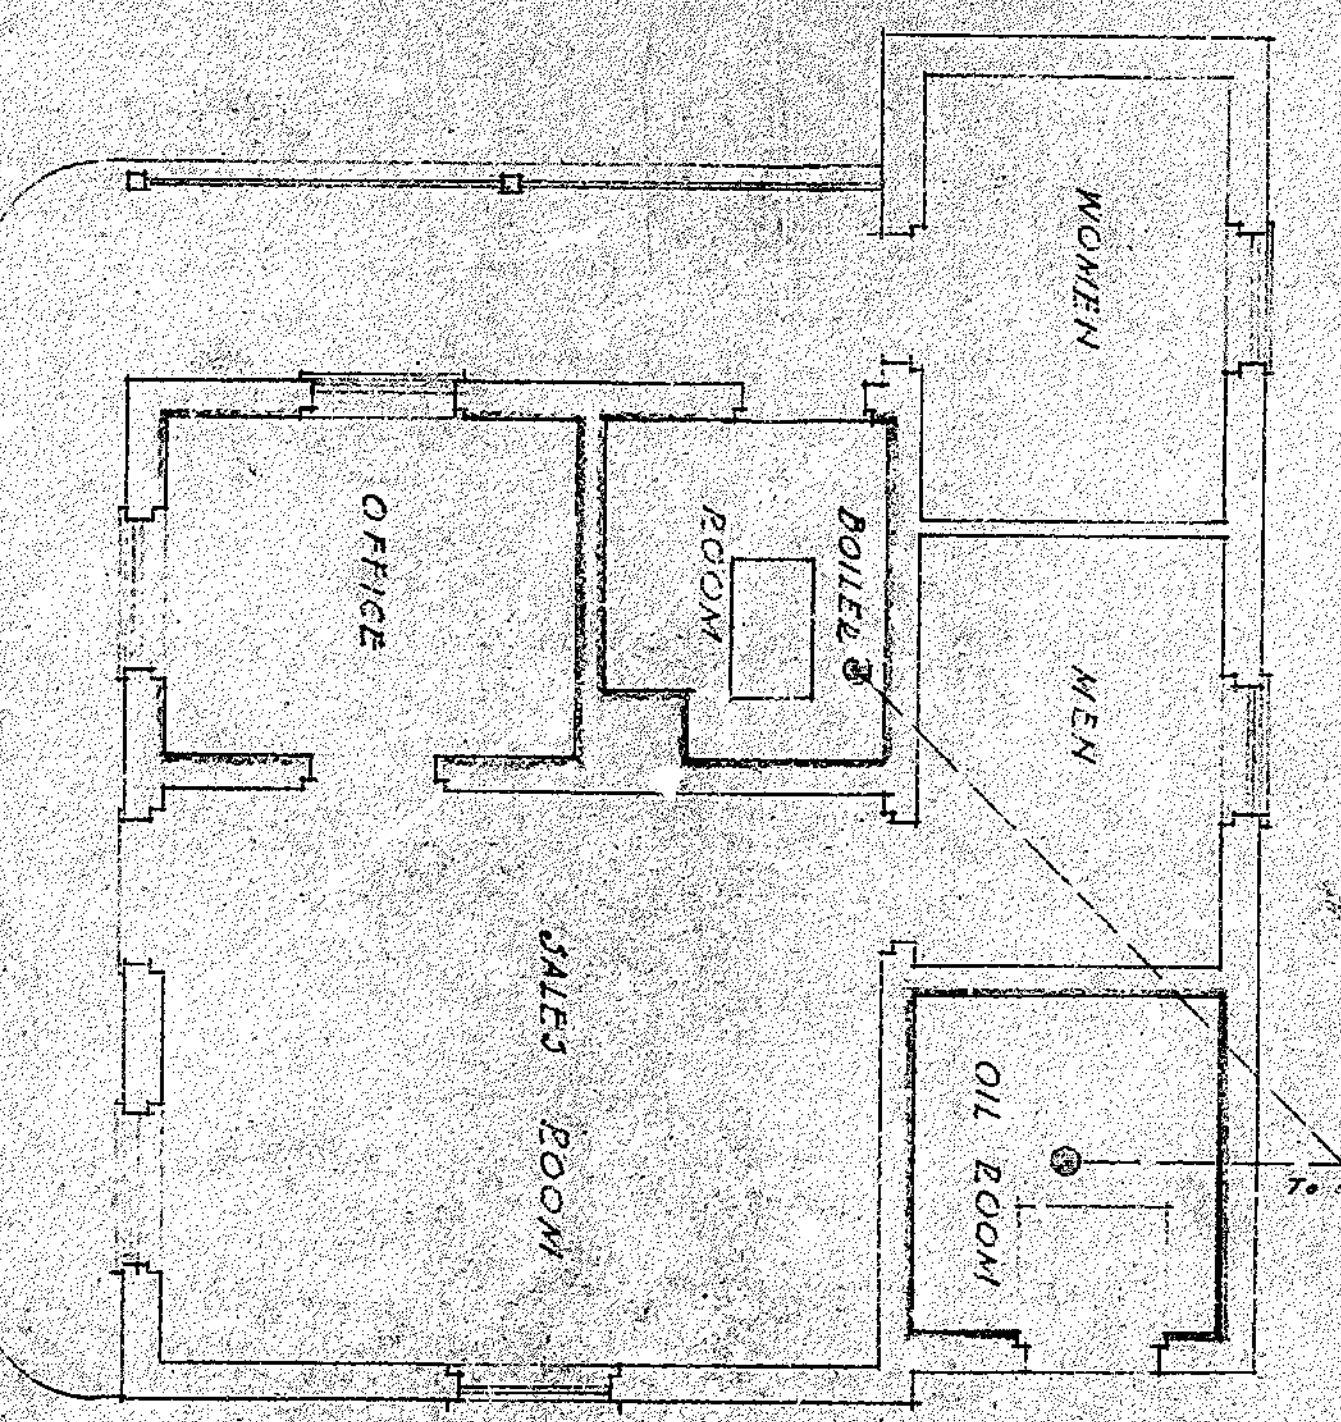

PLUMBING
SCALE 1/8"=1'-0"
NOTE: Deviations to approved DWG. N. PRY-BK-2005-C, Sheet 3



DEVIATIONS TO APPROVED DWG. N. PRY-BK-2005-C
SCALE 1/8"=1'-0"

RECOMMENDED BY SUPERINTENDENT O. E. PETERSON REGIONAL DIRECTOR	DATE 3/15/45	DEPARTMENT OF THE INTERIOR BUREAU OF RECLAMATION GAS STATION BUILDING NO. 62 POCAHONTAS, ARIZ.	REGION ONE SHEET 1 OF 1 DRAWING NO. PRY-BK-2005-C 3/15/45
APPROVED F. L. BERT REGIONAL DIRECTOR	DATE 3/15/45	DATE CHECKED 3/15/45	